

SPD

Surge Protective Device

SD25TxxxL306 Series

Description




Surge Protection Device (SPD) is a device that provides over voltage protection for various electronic equipment, instruments and communication lines. When there is a sudden power spike in an electrical circuit or communication line due to external interference, the current or voltage is high, the Surge Protective Device (SPD) can conduct and discharge in a very short time to prevent the power surge damaging other parts of the circuit.


Surge protective devices (SPD) are widely used in power system and network to play a big role for over-voltage protection.

SETsafe | SETfuse's Surge Protective Device SD25TxxxL306 series are mainly composed of varistor (MOV), pluggable module, base and internal and external electrode. Nominal discharge current: 25 kA, Maximum continuous operating voltage: (150 ~ 680)VAC, certification: UL, cUL, TUV, CE, complied with RoHS and REACH.

Dimensions (mm)

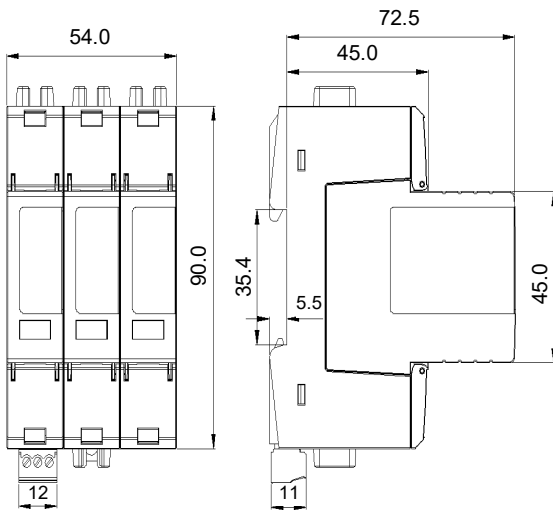

Schematics

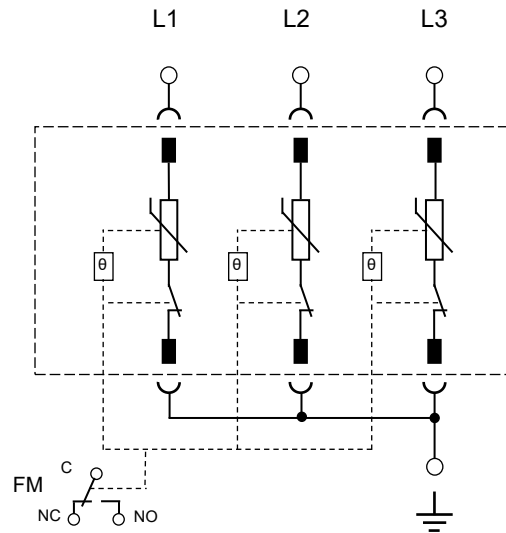

Features

- With Remote Signal Contact and Failure Indication
- Pluggable Module for Easy Replacement
- Comply with UL 1449 / IEC 61643-11
- Internal Thermal Protection, Fail-safe

Applications


- AC Power Supplies
- New Energy
- Residential Building
- Telecommunications
- Internet Data Center (IDC)
- Industrial Control

Features (SD25T)

Comply with UL 1449, IEC/EN 61643-11

Pluggable Module
Easy for replacement

Remote Signaling
Optional in all ranges, for remote signaling of modular end of life

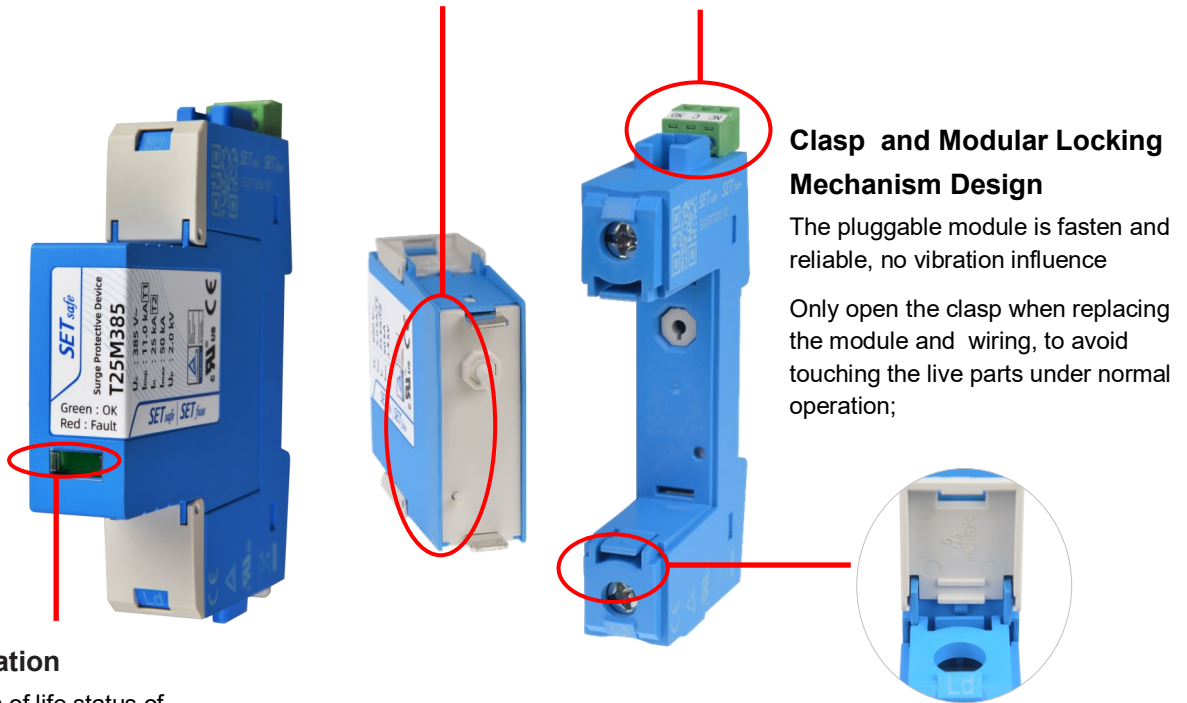

Clasp and Modular Locking Mechanism Design

The pluggable module is fasten and reliable, no vibration influence

Only open the clasp when replacing the module and wiring, to avoid touching the live parts under normal operation;

Failure Indication

Visual indication of life status of the protection device

Specifications


| Features | Specifications |
|---|--|
| Degrees of Protection of enclosure | IP20 |
| Wiring Ability | (1.5 ~ 25) mm ² (Flexible) / 35 mm ² (Rigid) |
| Installation | 35 mm DIN rail |
| Alarm | Remote + Indicator |
| Operating State / Fault Indication | Green (OK) / Red (Fault) |
| Remote Indication Contacts | AC: 250 V / 0.5 A, 125 V / 1 A DC: 250 V / 0.1 A, 125 V / 0.2 A, 75 A / 0.5 A |
| Cross-section of Remote Indication Conductors | 1.5 mm |
| Max. Main-side Overcurrent Protection | 200 A gL/gG |
| Short Current Rating I_{SCCR} | 25 kA |
| According to Standard | UL 1449, EN 61643-11 |
| Altitude | -500 ~ 5000 m |
| Operational Temperature Range | (-40 ~ 85) °C |

Specifications

| Model | Nominal System Voltage (U_n) | Max. Continuous Operating Voltage (U_c) | Impulse Discharge Current (10/350 μ s) (I_{imp}) | Nominal Discharge Current (8/20 μ s) (I_n) | Max. Discharge Current (8/20 μ s) (I_{max}) | Voltage Protection Level (U_p) | Modes of Protection | Agency | |
|--------------|----------------------------------|---|--|--|---|------------------------------------|---------------------|--------|----|
| | | | | | | | | TUV | UL |
| SD25T150L306 | 120 / 208 VAC | 150 VAC | 12.5 kA | 25 kA | 50 kA | 1.0 kV | 3+0 (L - PE) | ○ | ● |
| SD25T175L306 | 120 / 208 VAC | 175 VAC | 12.5 kA | 25 kA | 50 kA | 1.3 kV | | ○ | ● |
| SD25T275L306 | 240 VAC | 275 VAC | 12.5 kA | 25 kA | 50 kA | 1.5 kV | | ○ | ● |
| SD25T320L306 | 240 VAC | 320 VAC | 11.5 kA | 25 kA | 50 kA | 1.8 kV | | ○ | ● |
| SD25T385L306 | 230 / 400 VAC | 385 VAC | 11 kA | 25 kA | 50 kA | 2.0 kV | | ● | ● |
| SD25T440L306 | 277 / 480 VAC | 440 VAC | 10 kA | 25 kA | 50 kA | 2.1 kV | | ● | ● |
| SD25T510L306 | 347 / 600 VAC | 510 VAC | 7.5 kA | 25 kA | 50 kA | 2.5 kV | | ○ | ● |
| SD25T550L306 | 480 VAC | 550 VAC | 7.5 kA | 25 kA | 50 kA | 2.8 kV | | ○ | ● |
| SD25T680L306 | 600 VAC | 680 VAC | 5.0 kA | 25 kA | 50 kA | 3.2 kV | | ● | ● |



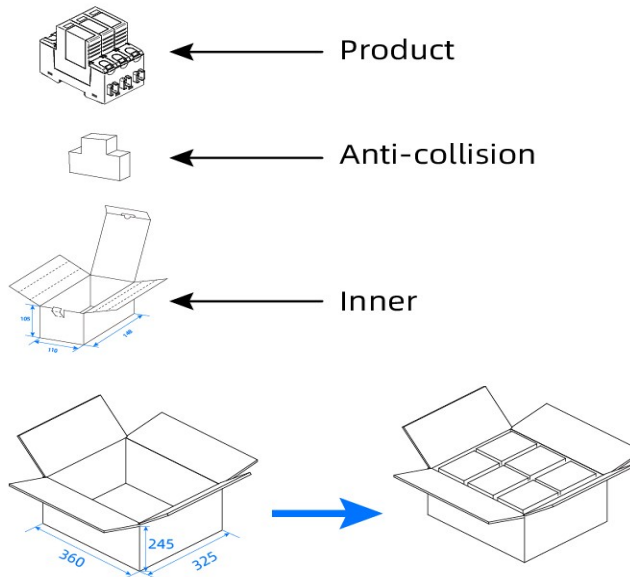

"●" indicates that the product has been certified, and "○" indicates that the product has not been certified.

Packaging Information




| Item | Inner | carton |
|-------------------|-----------------|-----------------|
| Package Size (mm) | 148 x 110 x 105 | 360 x 325 x 245 |
| Quantity (PCS) | 2 | 24 |

Agency Information

| Agency Information | | Standards | NO. | Category |
|---|-----|--------------------|------------|----------------------|
|  | UL | UL 1449 | E322662 | Type 4CA |
|  | CUL | CSA C22.2 NO.269.5 | E322662 | Type 4CA |
|  | TUV | IEC/EN 61643-11 | R 50441567 | Class II and Class I |
|  | CE | IEC/EN 61643-11 | AN 5053554 | Class II and Class I |

Part Numbering System

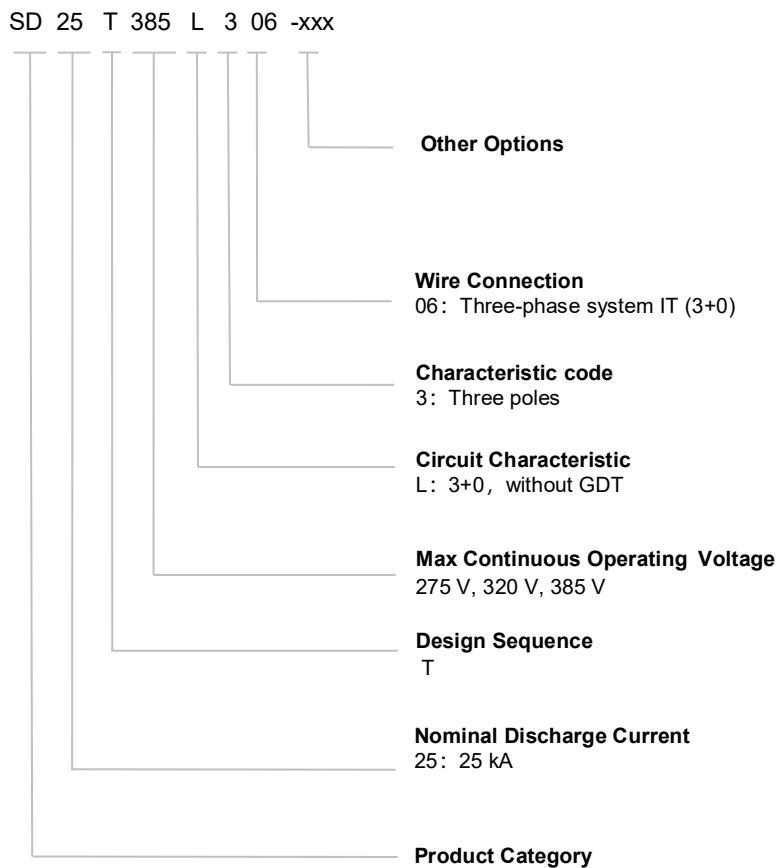


Reminder:


Part numbering system in the datasheet is only for selecting correct parameter and product features. Before placing order, please contact us for specifications and use the part number and product code in the specifications to place order to ensure the part is correct. Product code is the unique identification.

Wiring Diagram


Single phase system

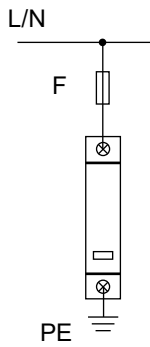

"1+0"
Connection

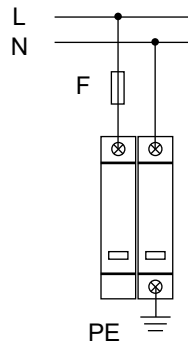


"2+0"
Connection

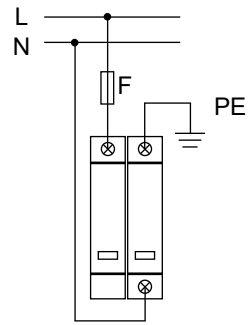


"1+1"
Connection


Three phase system

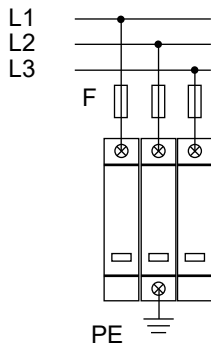

"3+0"
Connection

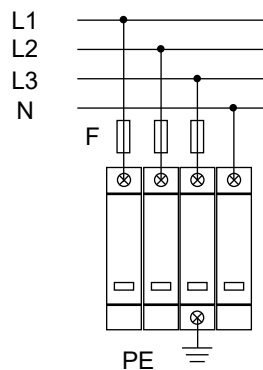





"4+0"
Connection

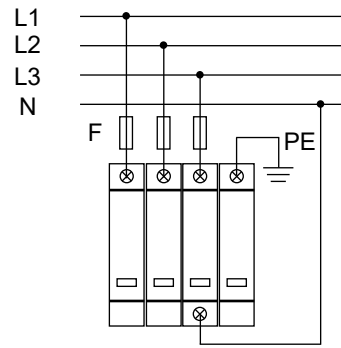

"3+1"
Connection

Connection of SPD in networks

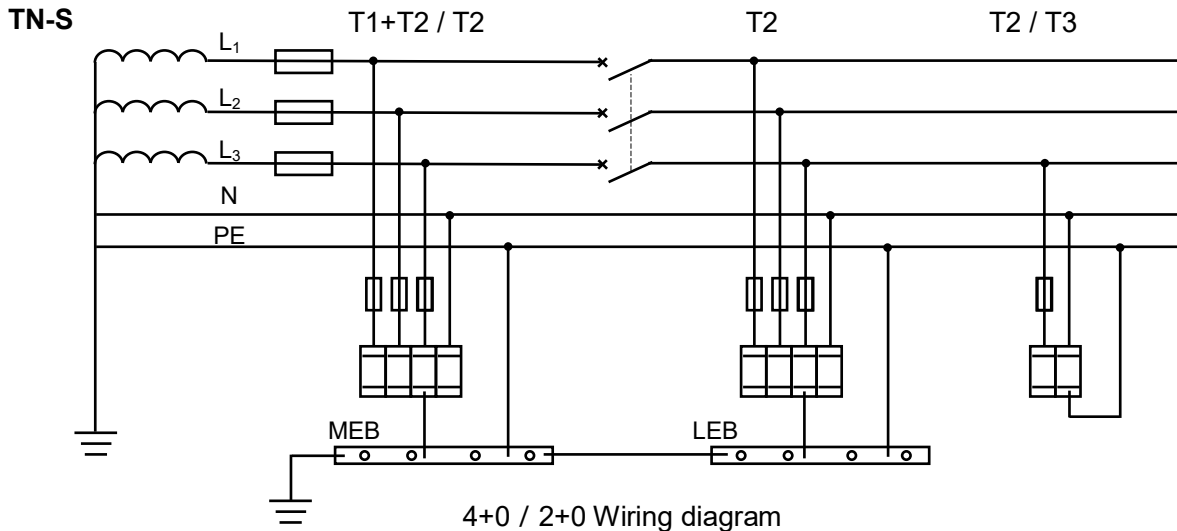

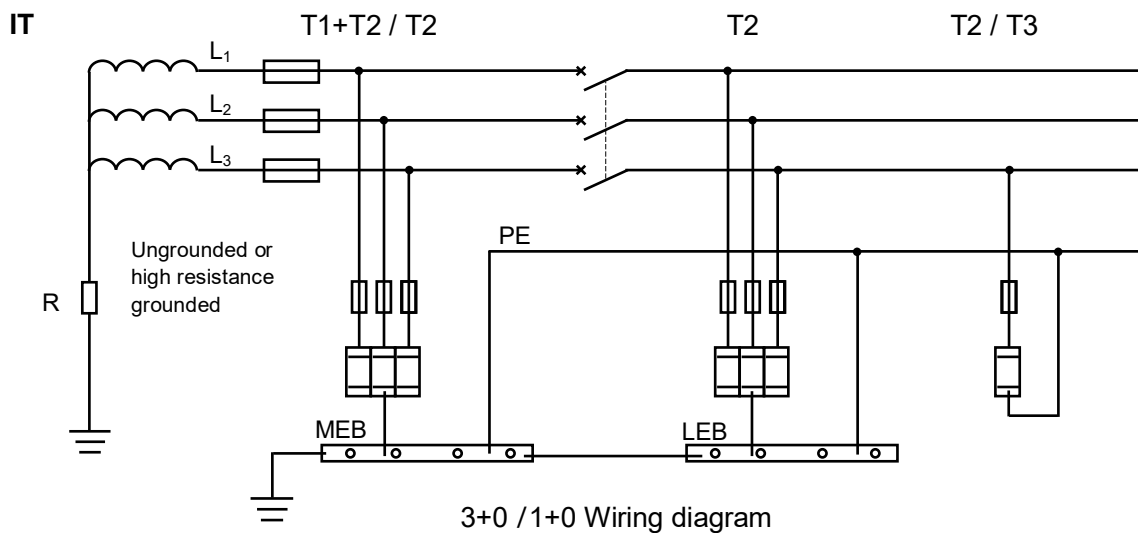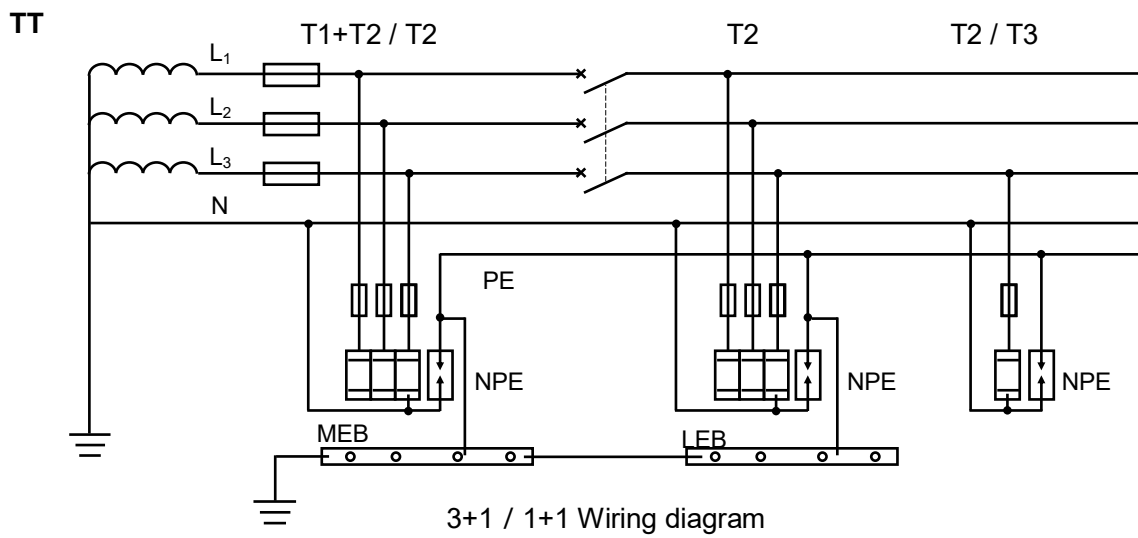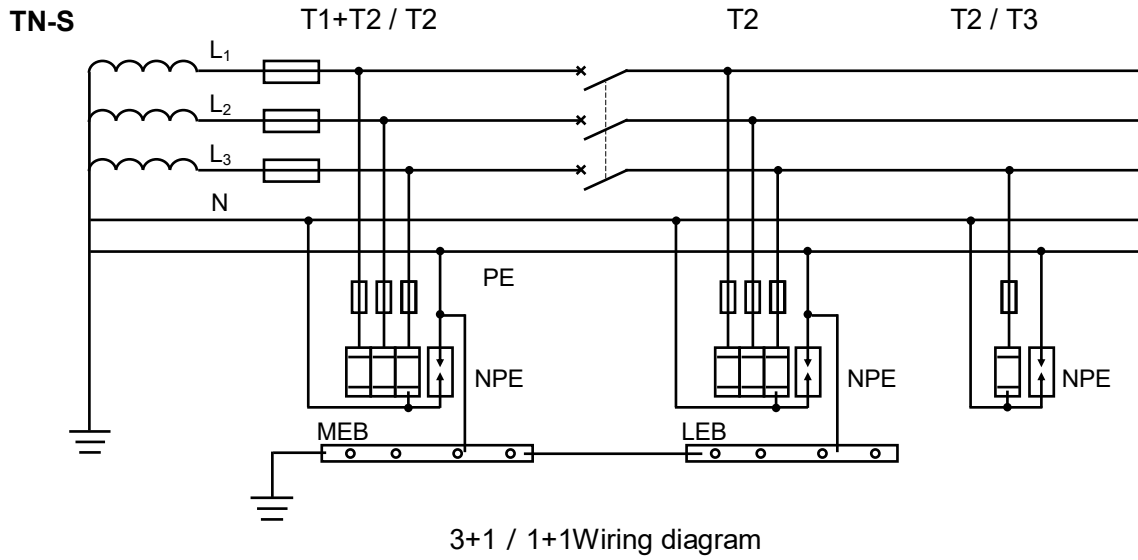

SPD

Surge Protective Device

Overvoltage

Electricity is an essential part of modern human production and life. But power facilities are threatened by internal and external overvoltages. Power system overvoltage mainly includes:

Transient overvoltage of atmospheric origin: Lightning strikes instantly generate high energy, generating surge currents up to hundreds of kA, and lightning wave can invade along power lines, causing damage to power facilities and electrical equipment

Transient overvoltage due to switching: Switching operations of a power utility may cause overvoltage.

Temporary overvoltage: A long duration (second level) temporary overvoltage (asymmetric ground fault) or harmonious overvoltage.


Surge Voltage Caused by Lightning

Electrical and electronic system are subject to damage from a lightning electromagnetic impulse (LEMP). Therefore SPD need to be provided avoid failure of internal system. LEMP may caused by direct, near and far lightning strikes. According to the relevant research, lightning strikes within a certain distance may cause dangerous overvoltage on the cable, endangering the equipment connected to it.


Damage Due to Lighting

The lighting can cause three basic type of damage:

- D1: injury to living beings by electric shock;
- D2: physical damage (fire, explosion, mechanical destruction, chemical release) due to lighting current effects, including sparking;
- D3: failure of internal systems due to LEMP

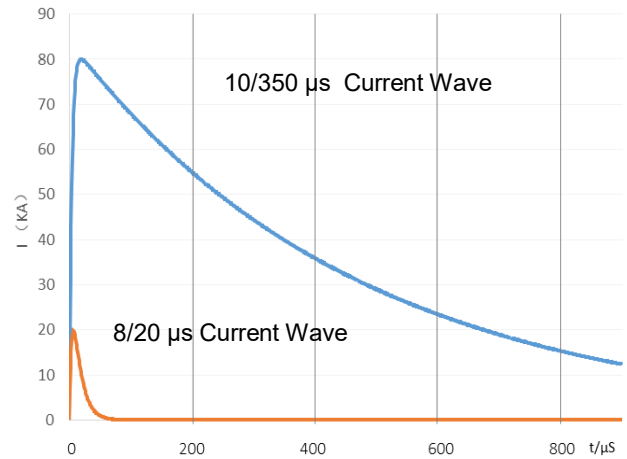

Standard lightning test wave

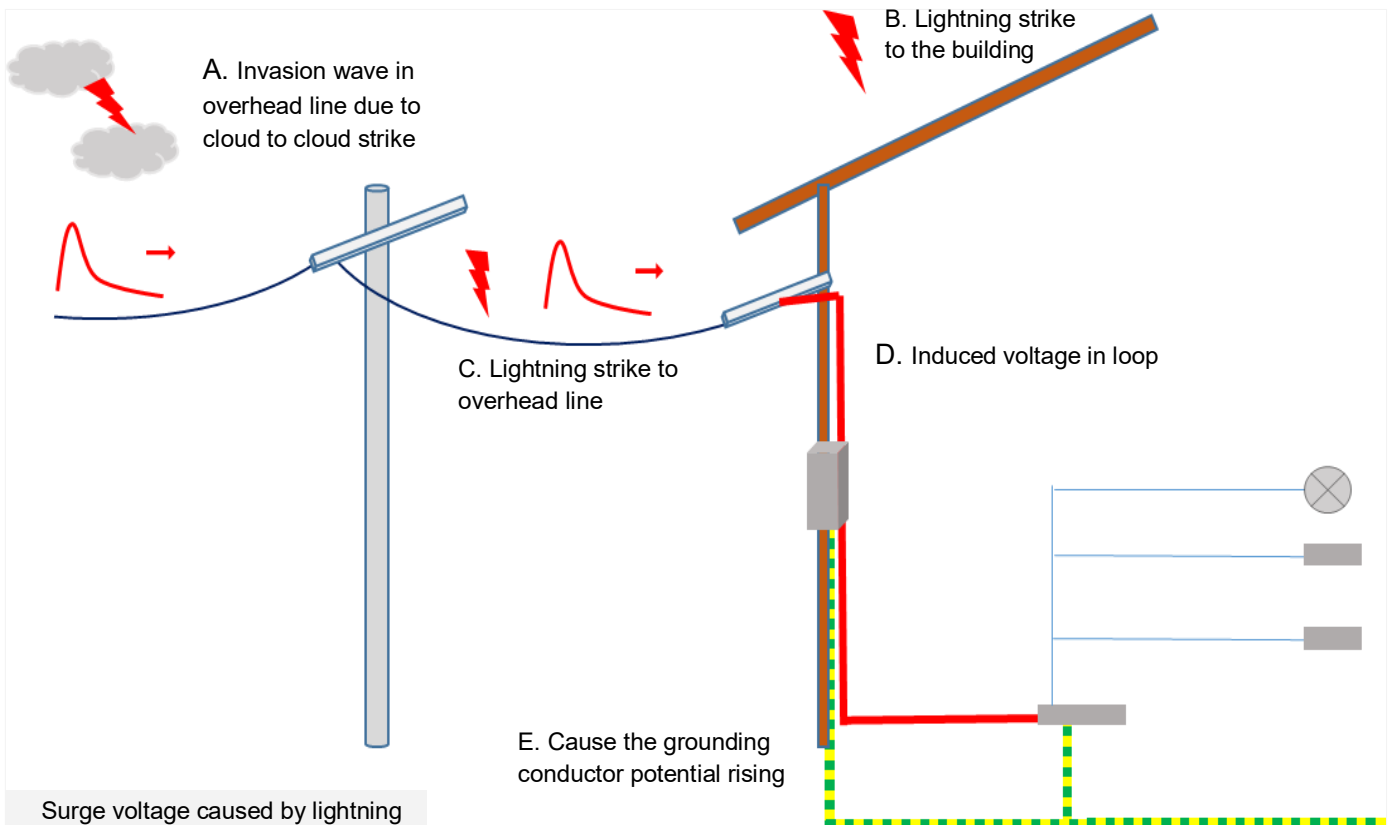

Surge voltage caused by lightning



SPD

Surge Protective Device

SD25TxxxL306 Series

Impulse Withstand Voltage and Surge Protection

As the primary equipment of internal lightning-proof, SPD needs to be able to withstand surge stress and provides the level of voltage protection required for the equipment. This involves the selection and coordination of SPD in different locations to form a complete protection system.

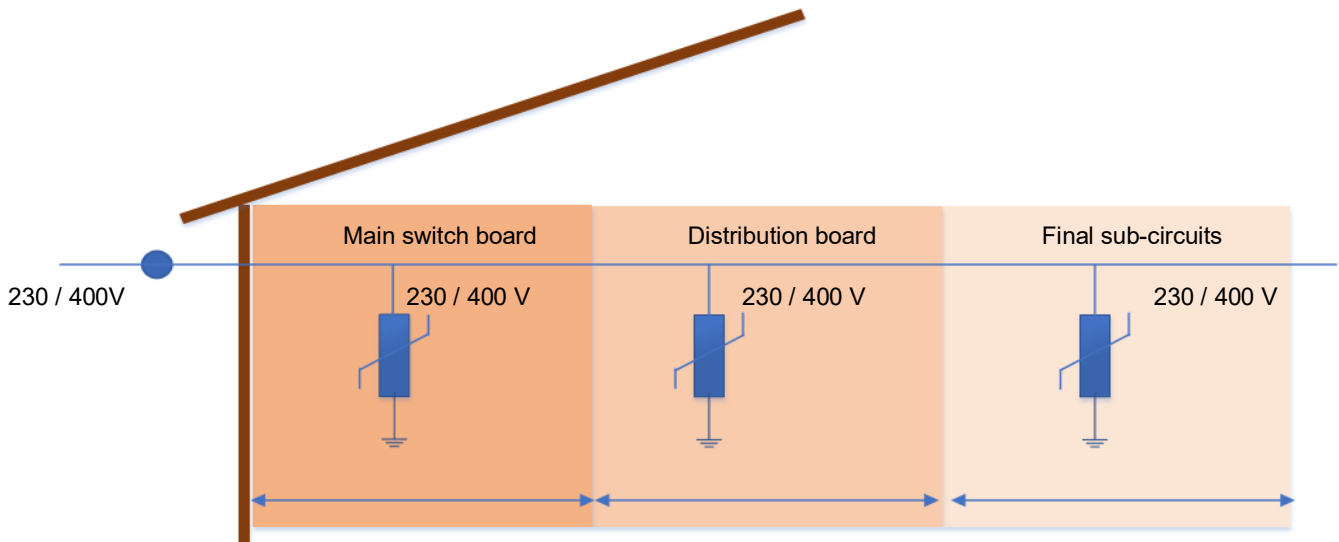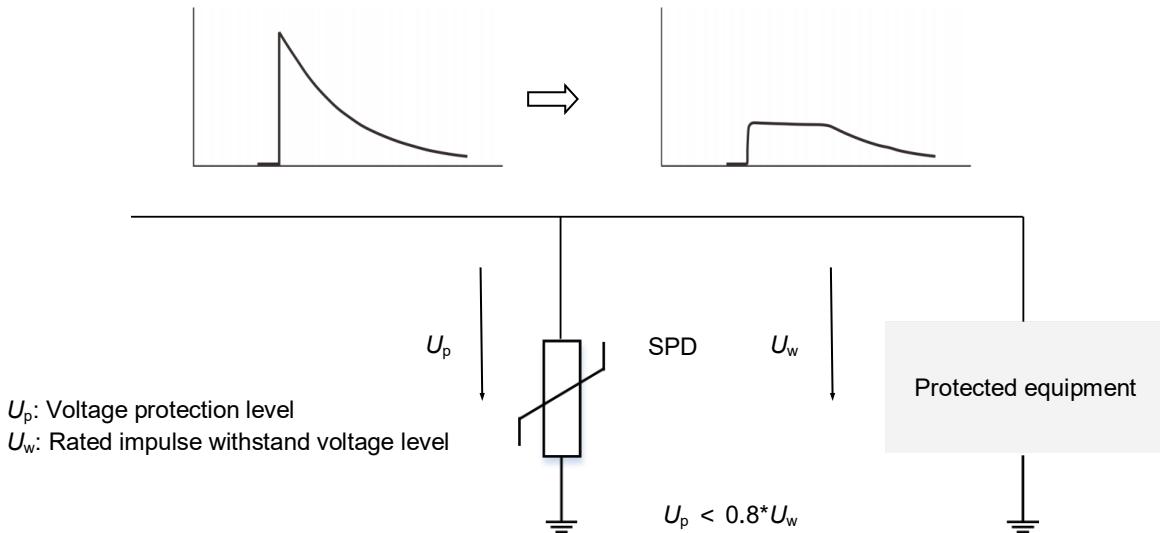

| | | | | |
|--------------------------------------|---------------------|----------|-----------------------|-----|
| Overvoltage Category | IV | III | II | I |
| U_w (kV) Impulse Withstand Voltage | 6 | 4 | 2.5 | 1.5 |
| Lightning Protection Zone LPZ | LPZ1 | LPZ2 | LPZn | |
| SPD Type | Class I or Class II | Class II | Class II or Class III | |

Glossary

| Item | Description |
|----------------------------|---|
| U_p | <p>Voltage Protection Level Maximum voltage to be expected at the SPD terminals due to an impulse stress with defined voltage steepness and an impulse stress with a discharge current with given amplitude and wave shape. — (IEC 61643-11)</p> |
| 8/20 μ s | <p>8/20 Current Impulse Current impulse with a nominal virtual front time of 8 μs and a nominal time to half-value of 20 μs. — (IEC 61643-11)</p> |
| 1.2/50 μ s | <p>1.2/50 Voltage Impulse Voltage impulse with a nominal virtual front time of 1.2 μs and a nominal time to half-value of 50 μs. — (IEC 61643-11)</p> |
| U_c | <p>Maximum Continuous Operating Voltage Maximum r.m.s. voltage, which may be continuously applied to the SPD's mode of protection. — (IEC 61643-11)</p> |
| I_n | <p>Nominal Discharge Current Crest value of the current through the SPD having a current waveshape of 8/20 μs. — (IEC 61643-11)</p> |
| I_{imp} | <p>Impulse Discharge Current for Class I Test Crest value of a discharge current through the SPD with specified charge transfer Q and specified energy W/R in the specified time. — (IEC 61643-11)</p> |
| I_{max} | <p>Maximum Discharge Current Crest value of a current through the SPD having an 8/20 μs waveshape and magnitude according to the manufacturers specification. I_{max} is equal to or greater than I_n. — (IEC 61643-11)</p> |
| Modes of Protection | <p>Modes of Protection An intended current path, between terminals that contains protective components, e.g. line-to-line, line-to-earth, line-to-neutral, neutral-to-earth. — (IEC 61643-11)</p> |
| IP | <p>Degrees of Protection of enclosure Classification preceded by the symbol IP indicating the extent of protection provided by an enclosure against access to hazardous parts, against ingress of solid foreign objects and possibly harmful ingress of water. — (IEC 60529)</p> |
| TCO | <p>Thermal-Link A non-resettable device incorporating a THERMAL ELEMENT which will open a circuit once only when exposed for a sufficient length of time to a temperature in excess of that for which it has been designed.</p> |
| ATCO | <p>Alloy Thermal-Link Alloy Type Thermal-Link, Alloy is the thermal element.</p> |



ATTENTION

Usage

1. The voltage applied continuously to the SPD must not exceed its maximum continuous operating voltage U_c .
2. When atmosphere press is from 54 kPa to 106 kPa, the related altitude shall be from 5000 m to - 500 m.
3. Do not touch the product body or wires directly when power is on, to avoid electric shock.

Replacement

As SPD is a non-repairable product, for safety sake, please use the same type of SPD for replacement.

Storage

Do not store SPD at high temperature, high humidity or corrosive gas environment. Use them up within 2 years after receiving the goods.

Installation

1. Installation and startup may only be carried out by qualified personnel. The relevant country-specific regulations must be observed.
2. Check the device for external damage before installation. If the device is defective, it must not be used.
3. Pay attention to risk of electric shock. Please cutoff all electrical power before installation or service.
4. Lay the output cables to the surge protective devices (SPDs) as short as possible, without loops.
5. Please install proper backup protection devices in front of SPD.
6. Do not apply mechanical stress to the SPD body during or after the installation.

Maintenance

1. Check SPD status according to instructions before and after the thunderstorm season each year.
2. If the indicator of "failure state" appears, the SPD is damaged. Replace the SPD with same type.
3. Ensure electrical connections and mountings are correct before energizing the circuit.
4. SPD's quality is well controlled and strictly inspected before delivery. If non-functional ones are found during operation, please contact us early enough.